


FLOW ATLAS 003

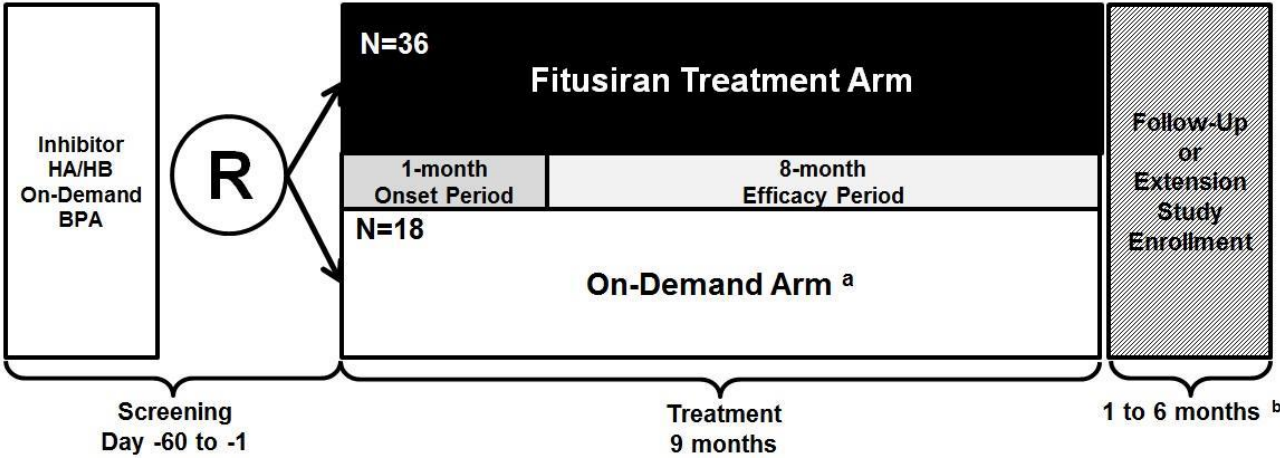

Abbreviations: BPA = bypassing agent; HA/HB = hemophilia type A / hemophilia type B; R = randomized

^aOn-demand local BPA as routinely prescribed by physician per local standard practice.

^bFitusiran treatment arm patients who do not enroll in the extension study: AT activity level will be monitored at monthly intervals following the final fitusiran dose until activity levels return to approximately 60% (per the central laboratory) or per Investigator discretion in consultation with the study Medical Monitor.